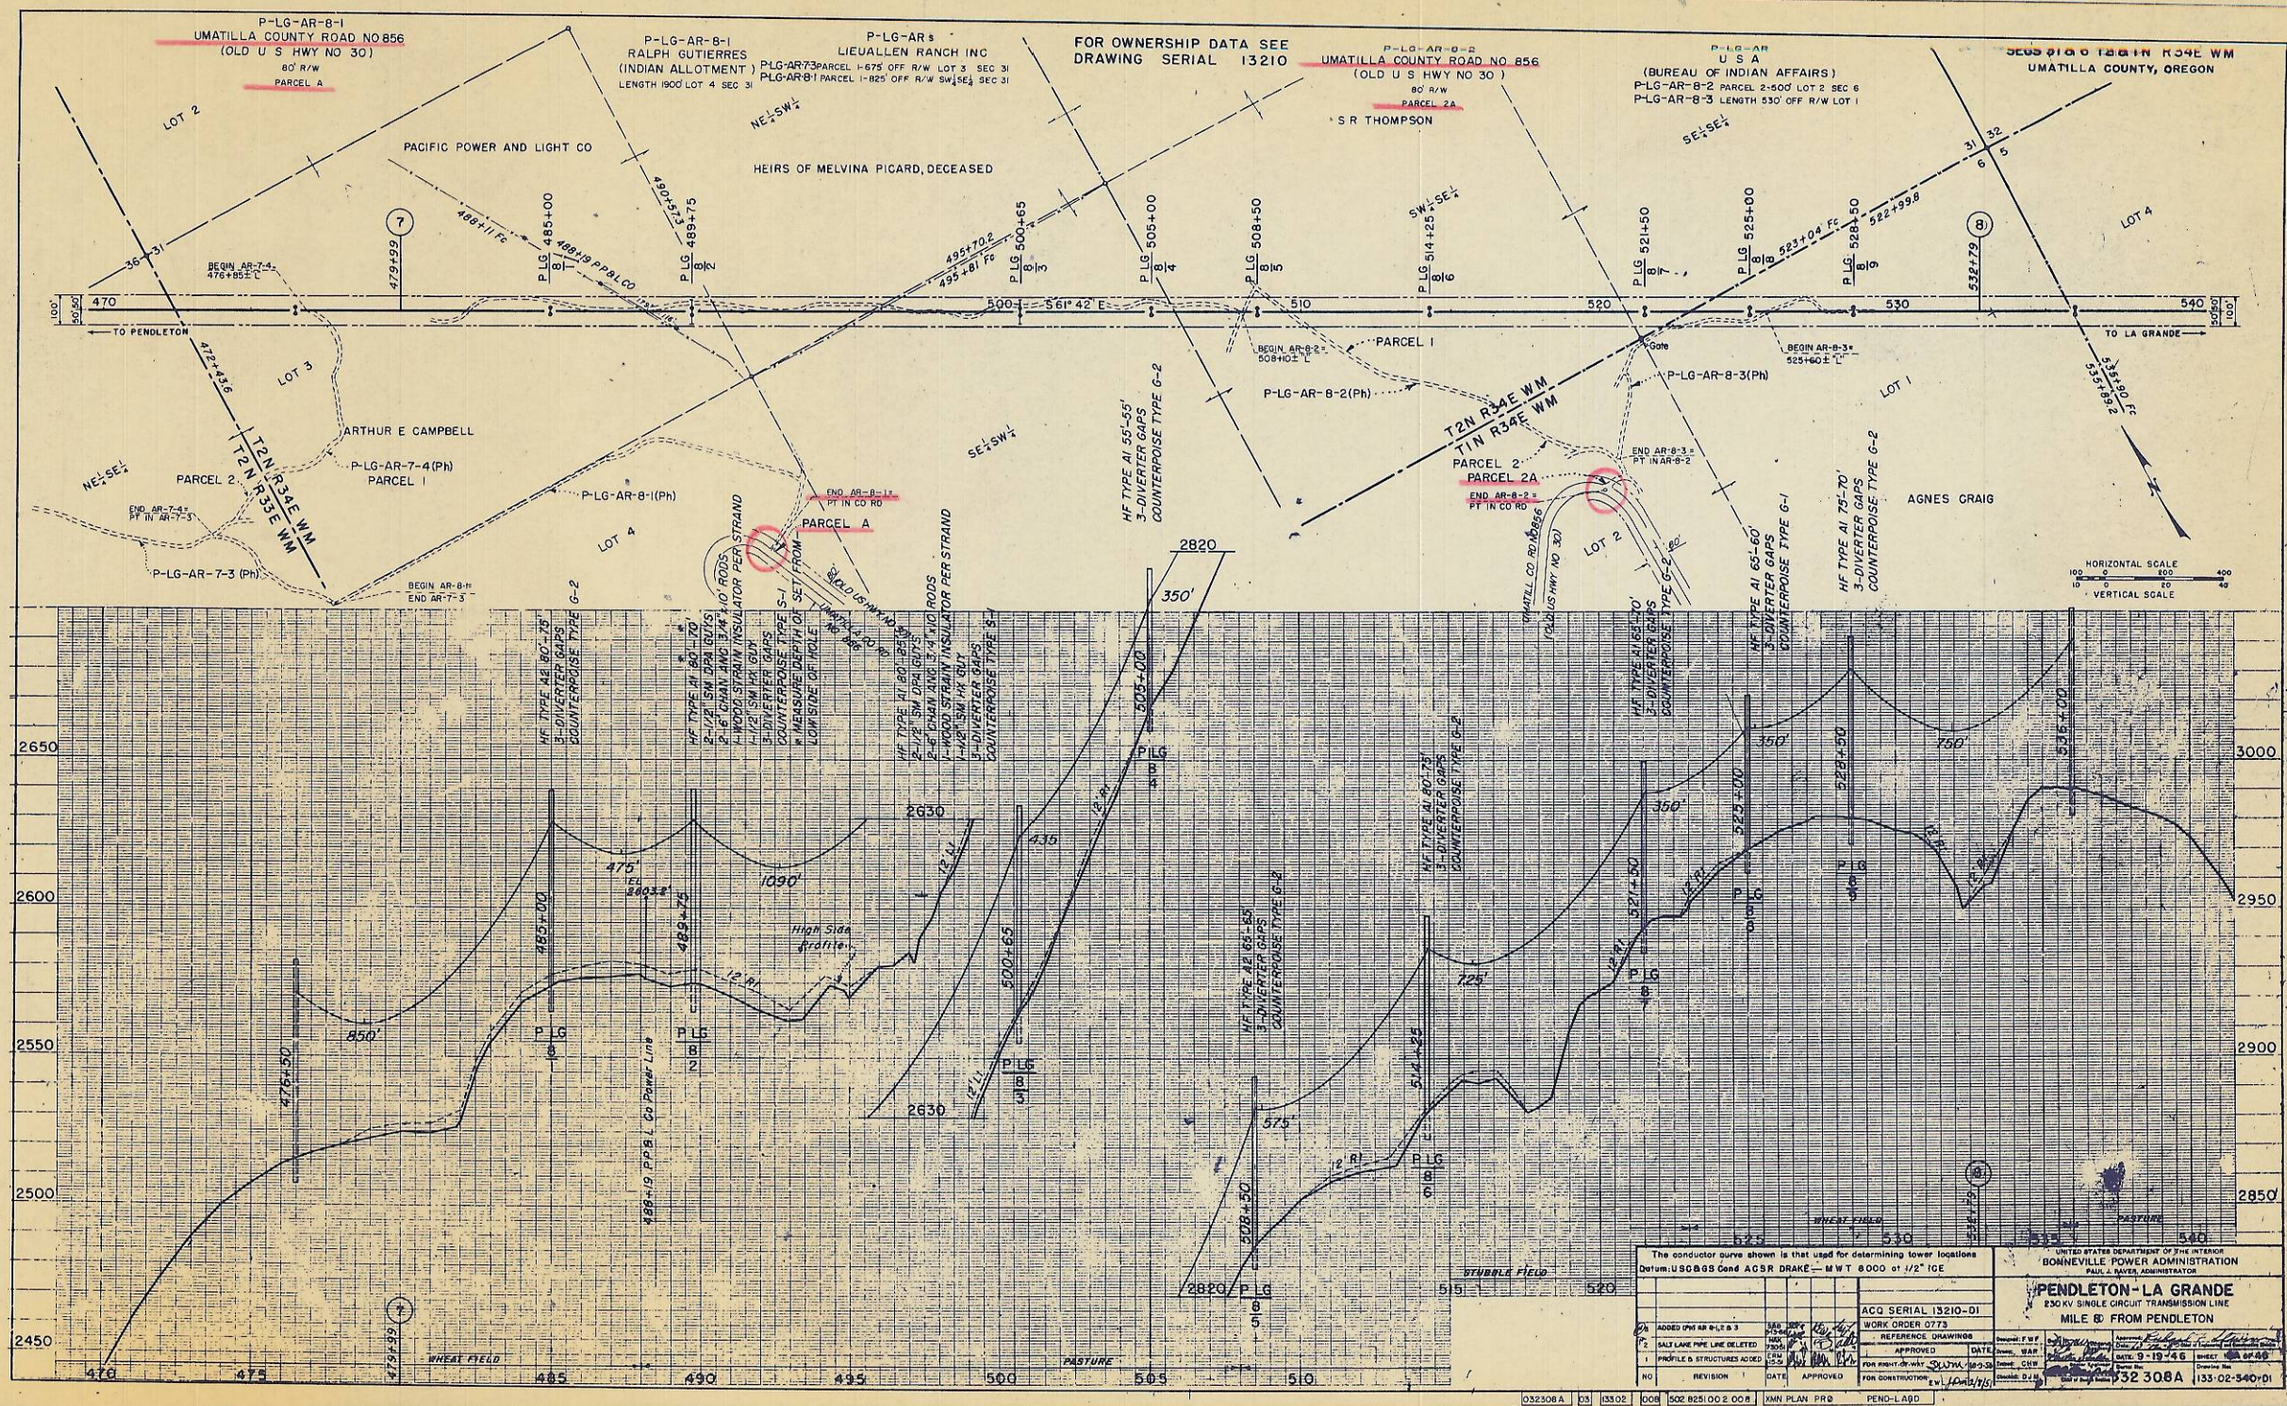
P-LG-AR-8-1
UMATILLA COUNTY ROAD NO 856
(OLD U S HWY NO 30)
80' R/W
PARCEL A
P-LG-AR-8-1
RALPH GUTIERRES
(INDIAN ALLOTMENT)
LENGTH 1900' LOT 4 SEC 31
P-LG-AR-8
LIEUALLEN RANCH INC
P-LG-AR-7-3 PARCEL 1-675' OFF R/W LOT 3 SEC 31
P-LG-AR-8-1 PARCEL 1-825' OFF R/W SW¼SE¼ SEC 31
FOR OWNERSHIP DATA SEE
DRAWING SERIAL 13210
P-LG-AR-8-2
UMATILLA COUNTY ROAD NO 856
(OLD U S HWY NO 30)
80' R/W
PARCEL 2A
S R THOMPSON
P-LG-AR
U S A
(BUREAU OF INDIAN AFFAIRS)
P-LG-AR-8-2 PARCEL 2-500' LOT 2 SEC 6
P-LG-AR-8-3 LENGTH 530' OFF R/W LOT 1
SEC 31 & 6 T2S R34E WM
UMATILLA COUNTY, OREGON
PACIFIC POWER AND LIGHT CO
HEIRS OF MELVINA PICARD, DECEASED
LOT 2
LOT 3
LOT 4
LOT 1
ARTHUR E CAMPBELL
AGNES CRAIG
PARCEL 1
PARCEL 2
PARCEL I
PARCEL 2
PARCEL 2A
P-LG-AR-7-4(Ph)
P-LG-AR-8-1(Ph)
P-LG-AR-8-2(Ph)
P-LG-AR-8-3(Ph)
P-LG-AR-7-3 (Ph)
BEGIN AR-7-4
476+85± L
END AR-7-4
PT IN AR-7-3
BEGIN AR-8-1
END AR-7-3
END AR-8-1
PT IN CO RD
BEGIN AR-8-2
508+40± L
END AR-8-2
PT IN CO RD
BEGIN AR-8-3
525+60± L
END AR-8-3
PT IN AR-8-2
T2N R33E WM
T2N R34E WM
T1N R34E WM
TO PENDLETON
TO LA GRANDE
Gate
UMATILLA CO RD NO 856
(OLD US HWY NO 30)
HF TYPE A1 55'-55'
3-DIVERTER GAPS
COUNTERPOISE TYPE G-2
HF TYPE A1 75'-70'
3-DIVERTER GAPS
COUNTERPOISE TYPE G-1
HF TYPE A1 65'-60'
3-DIVERTER GAPS
COUNTERPOISE TYPE G-2
HF TYPE A4 80'-75'
3-DIVERTER GAPS
COUNTERPOISE TYPE G-2
HF TYPE A2 65'-55'
3-DIVERTER GAPS
COUNTERPOISE TYPE G-2
HF TYPE H 80'-70'
2-1/2" SM DPA GUYS
2-6" CHAIN ANC 3/4"x10' RODS
1-WOOD STRAIN INSULATOR PER STRAND
1-1/2" SM HR GUY
3-DIVERTER GAPS
COUNTERPOISE TYPE S-1
* MEASURE DEPTH OF SET FROM LOW SIDE OF HOLE
HF TYPE A1 80'-75'
2-1/2" SM DPA GUYS
2-6" CHAIN ANC 3/4"x10' RODS
1-WOOD STRAIN INSULATOR PER STRAND
1-1/2" SM HR GUY
3-DIVERTER GAPS
COUNTERPOISE TYPE S-1
HORIZONTAL SCALE
VERTICAL SCALE
488+19 PP&L Co Power Line
High Side Profile
WHEAT FIELD
PASTURE
STUBBLE FIELD
The conductor curve shown is that used for determining tower locations
Datum: USC&GS Cond ACSR DRAKE — MWT 8000 at 1/2" ICE
ADDED (PN) AR 8-1, 2 & 3
SALT LAKE PIPE LINE DELETED
PROFILE & STRUCTURES ADDED
REVISION
DATE
APPROVED
ACQ SERIAL 13210-D1
WORK ORDER 0773
REFERENCE DRAWINGS
APPROVED
DATE
FOR RIGHT-OF-WAY
FOR CONSTRUCTION
UNITED STATES DEPARTMENT OF THE INTERIOR
BONNEVILLE POWER ADMINISTRATION
PAUL J. RAYER, ADMINISTRATOR
PENDLETON - LA GRANDE
230 KV SINGLE CIRCUIT TRANSMISSION LINE
MILE 80 FROM PENDLETON
Designed: F W F
Drawn: WAR
Traced: CHR
Checked: D J M
Approved: Richard L. Guzman
Date: 9-19-46
Sheet: 1 of 40
Drawing No. P32 308A
Supersedes Drawing No. 133-02-540-D1

29