
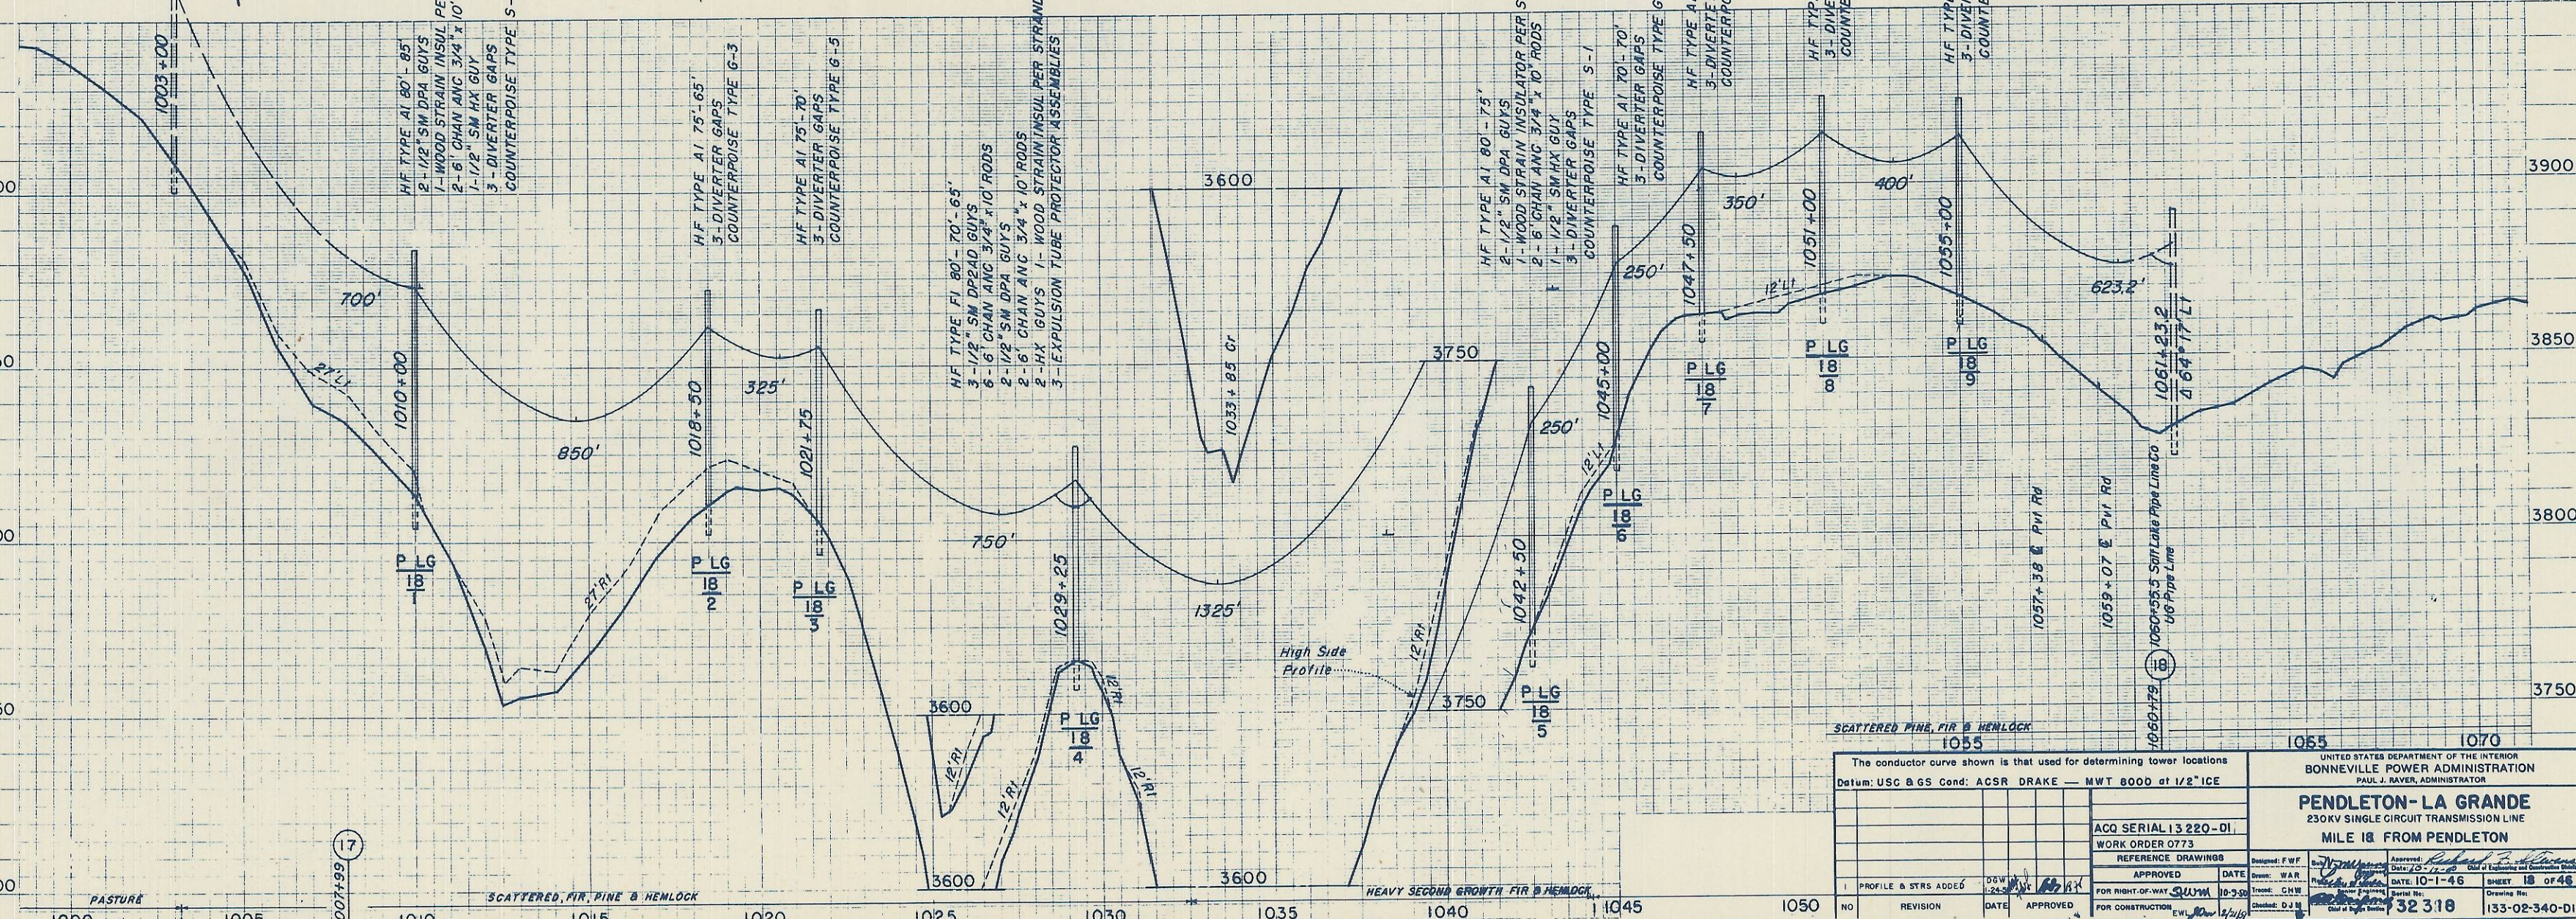



FOR OWNERSHIP DATA SEE
DRAWING SERIAL 13 220

SECS 21, 20 & 29 T1N R35E WM
UMATILLA COUNTY, OREGON

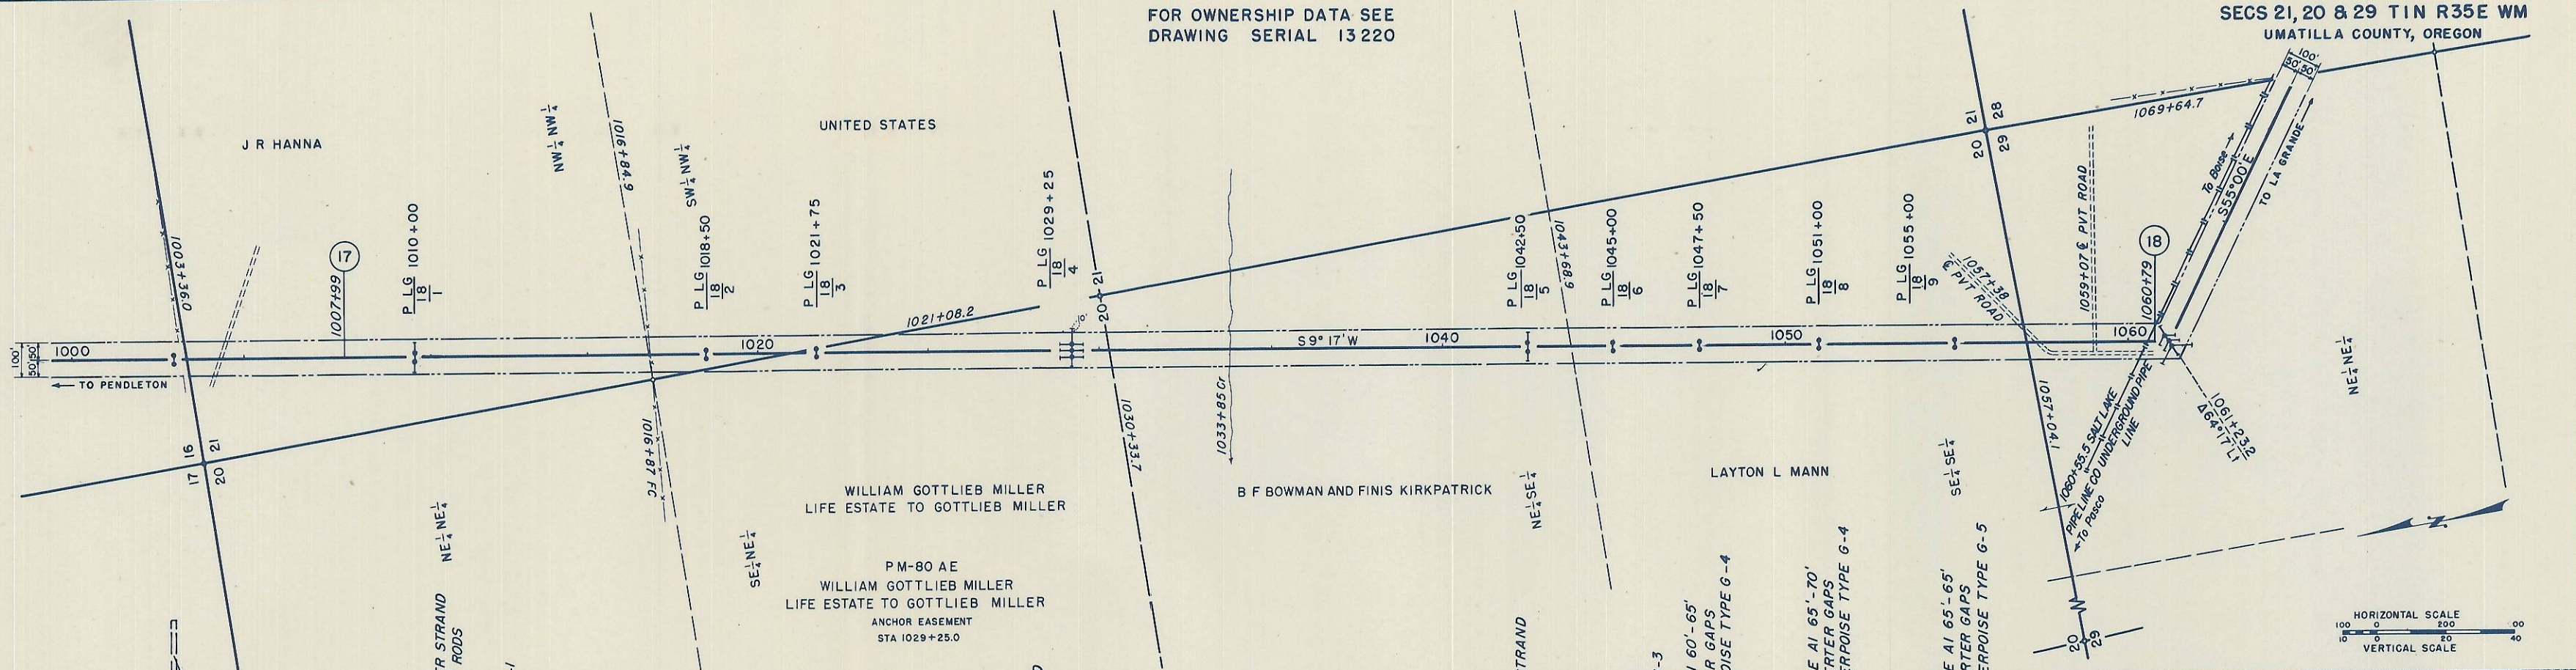

<p>SCATTERED PINE, FIR & HEMLOCK</p>		<p>1055</p>		<p>1065</p>		<p>1070</p>	
<p>The conductor curve shown is that used for determining tower locations Datum: USC & GS Cond: ACSR DRAKE — MWT 8000 at 1/2" ICE</p>							
<p>ACQ SERIAL 13 220-01 WORK ORDER 0773</p>				<p>UNITED STATES DEPARTMENT OF THE INTERIOR BONNEVILLE POWER ADMINISTRATION PAUL J. RAYER, ADMINISTRATOR</p>			
<p>REFERENCE DRAWINGS</p>				<p>DESIGNED: F W F DATE: 10-1-46 SHEET 18 OF 46</p>			
<p>APPROVED</p>		<p>DATE</p>		<p>FOR RIGHT-OF-WAY</p>		<p>DATE: 10-1-46</p>	
<p>FOR CONSTRUCTION</p>		<p>DATE</p>		<p>FOR CONSTRUCTION</p>		<p>DATE: 10-1-46</p>	
<p>NO</p>		<p>REVISION</p>		<p>DATE</p>		<p>APPROVED</p>	
<p>NO</p>		<p>REVISION</p>		<p>DATE</p>		<p>APPROVED</p>	