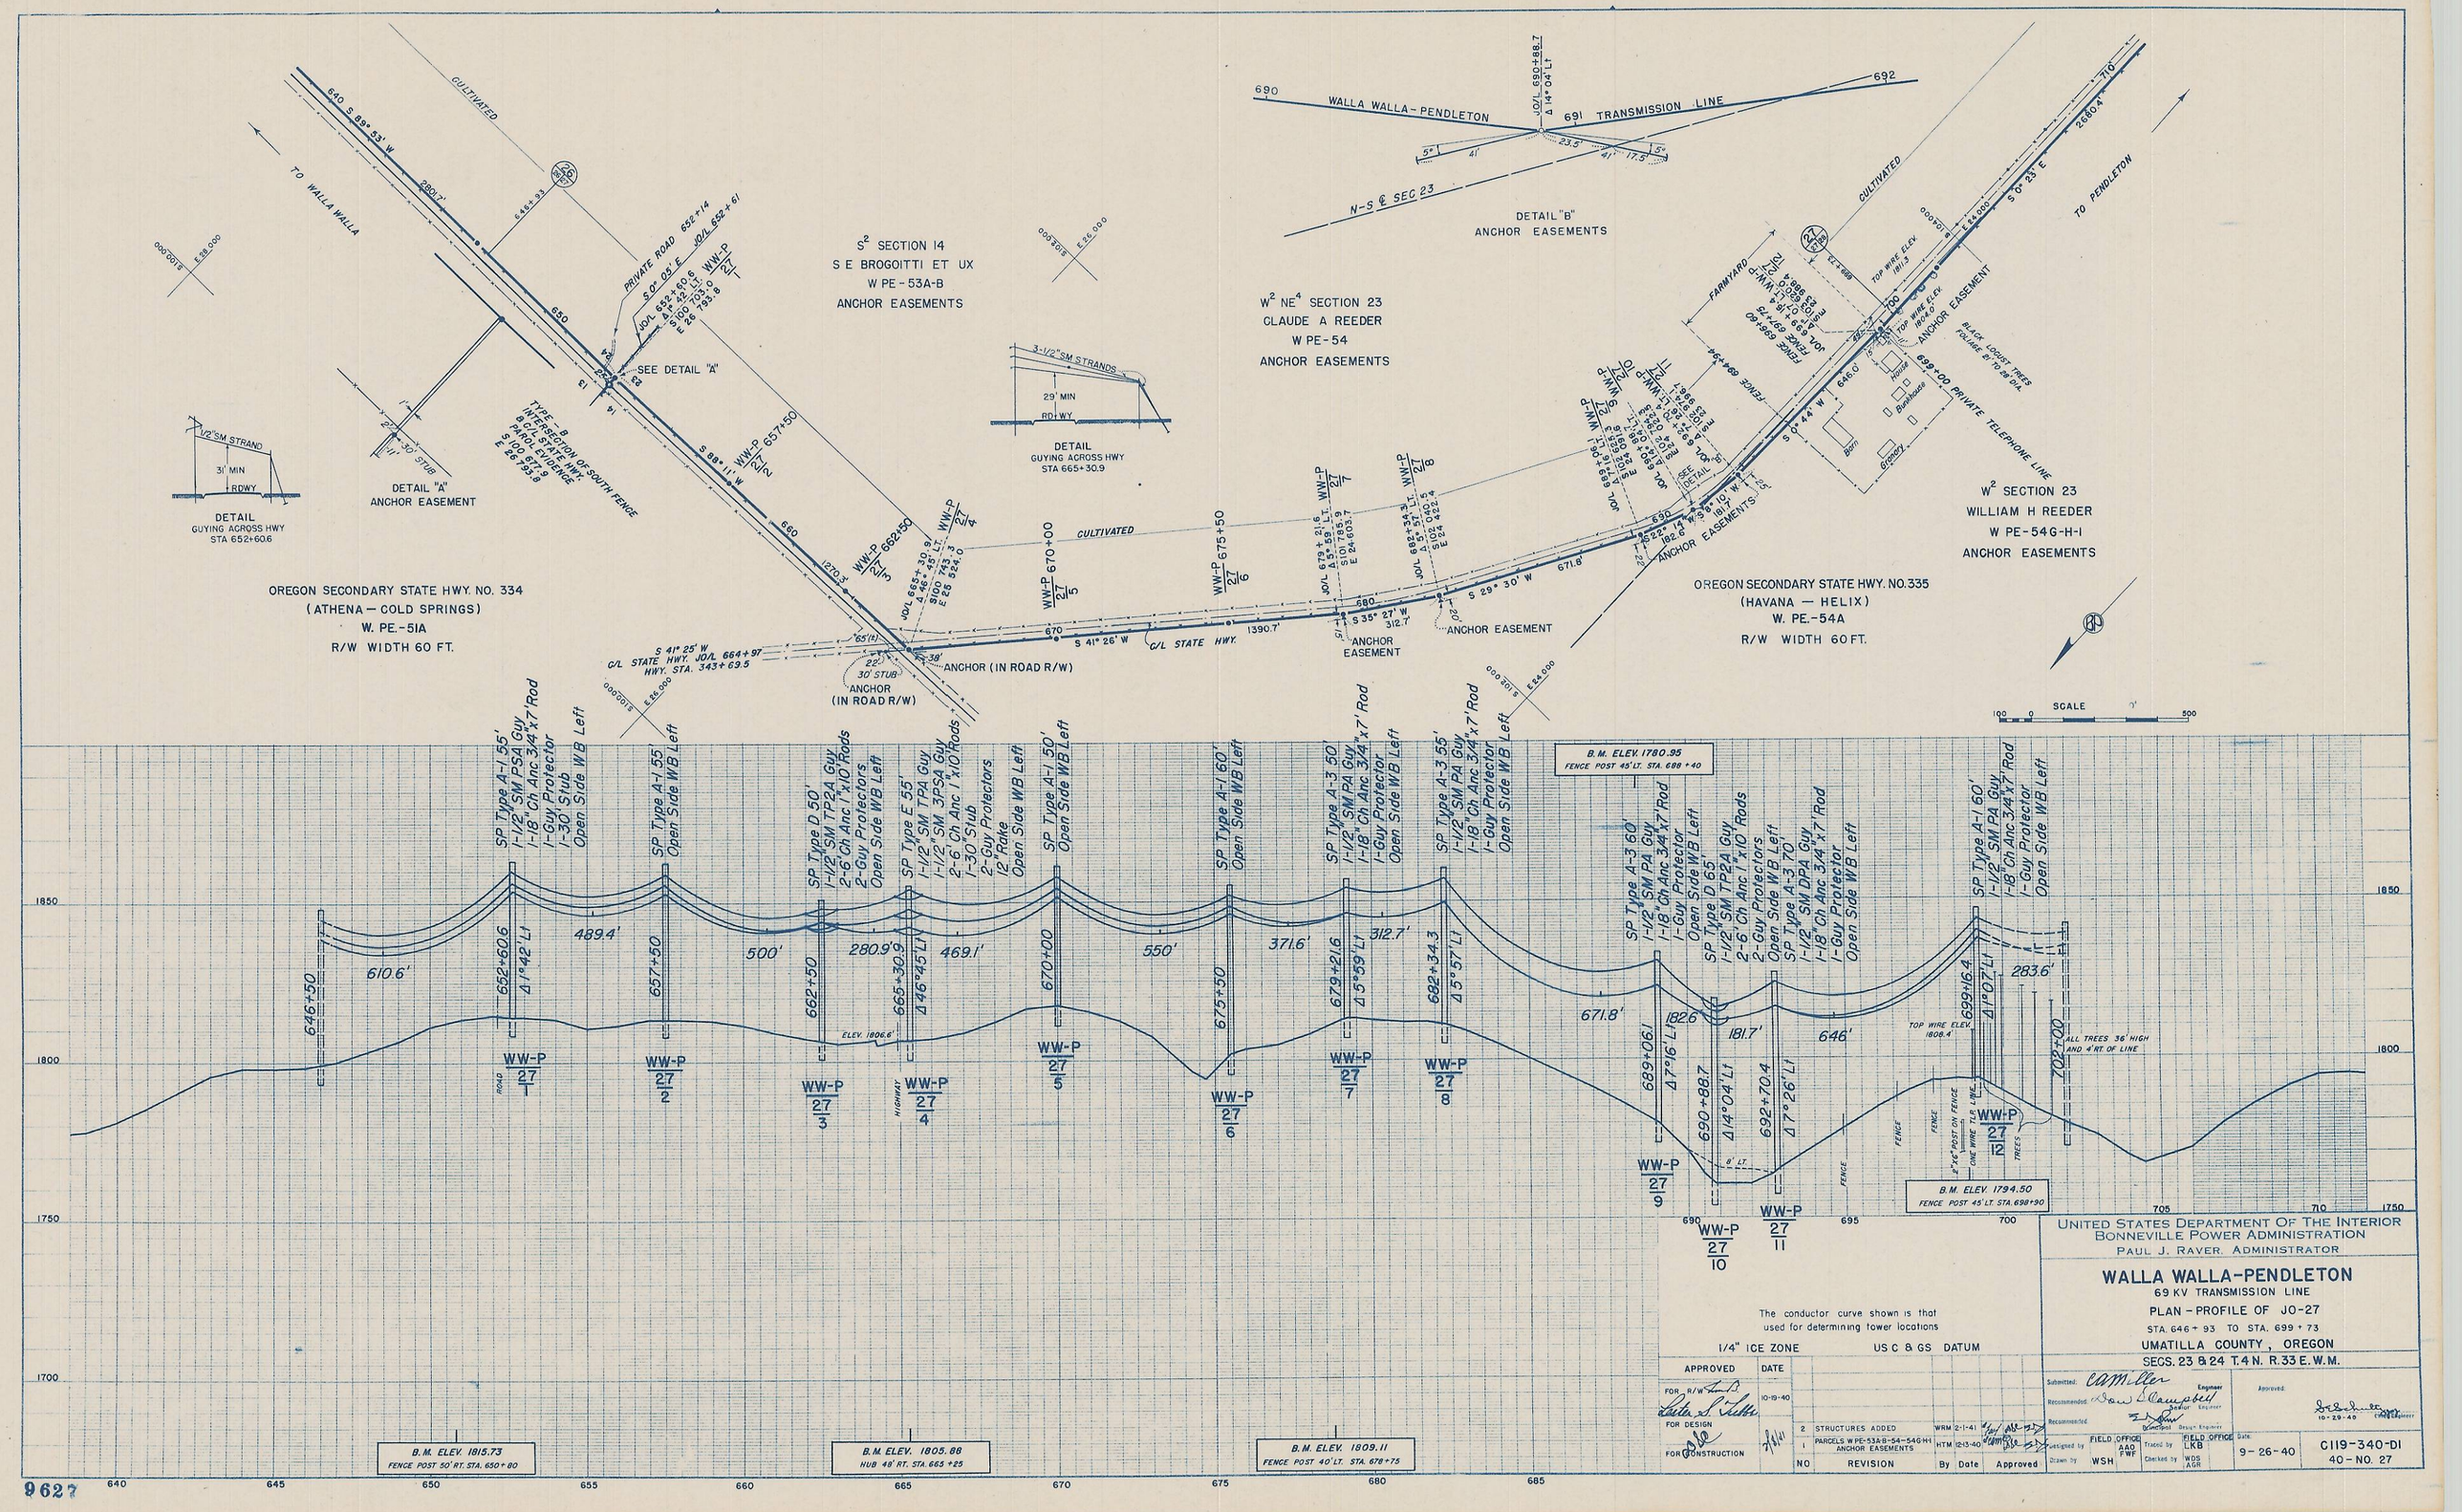

The conductor curve shown is that used for determining tower locations

1/4" ICE ZONE US C & GS DATUM

APPROVED	DATE
FOR R/W Lester A. Tibbs	10-19-40
FOR DESIGN	
FOR CONSTRUCTION	7/11/41

NO	REVISION	By	Date	Approved
2	STRUCTURES ADDED	WRM	2-1-41	
1	PARCELS W PE-53A-B-54-54G-H-I ANCHOR EASEMENTS	HTM	12-13-40	

UNITED STATES DEPARTMENT OF THE INTERIOR
BONNEVILLE POWER ADMINISTRATION
PAUL J. RAVER, ADMINISTRATOR

WALLA WALLA-PENDLETON
69 KV TRANSMISSION LINE
PLAN - PROFILE OF JO-27
STA. 646+93 TO STA. 699+73
UMATILLA COUNTY, OREGON
SECS. 23 & 24 T. 4 N. R. 33 E. W.M.

Submitted: C.A. Miller, Engineer
Recommended: Chas. L. Campbell, Senior Engineer
Recommended: [illegible], Assistant Design Engineer
Approved: [illegible], Chief Engineer, 10-29-40
Designed by: WSH
Drawn by: WSH
Traced by: LKB
Checked by: WDS AGR
FIELD OFFICE: AAO FWF
FIELD OFFICE:
Date: 9-26-40
C119-340-D1
40 - NO. 27

9627