
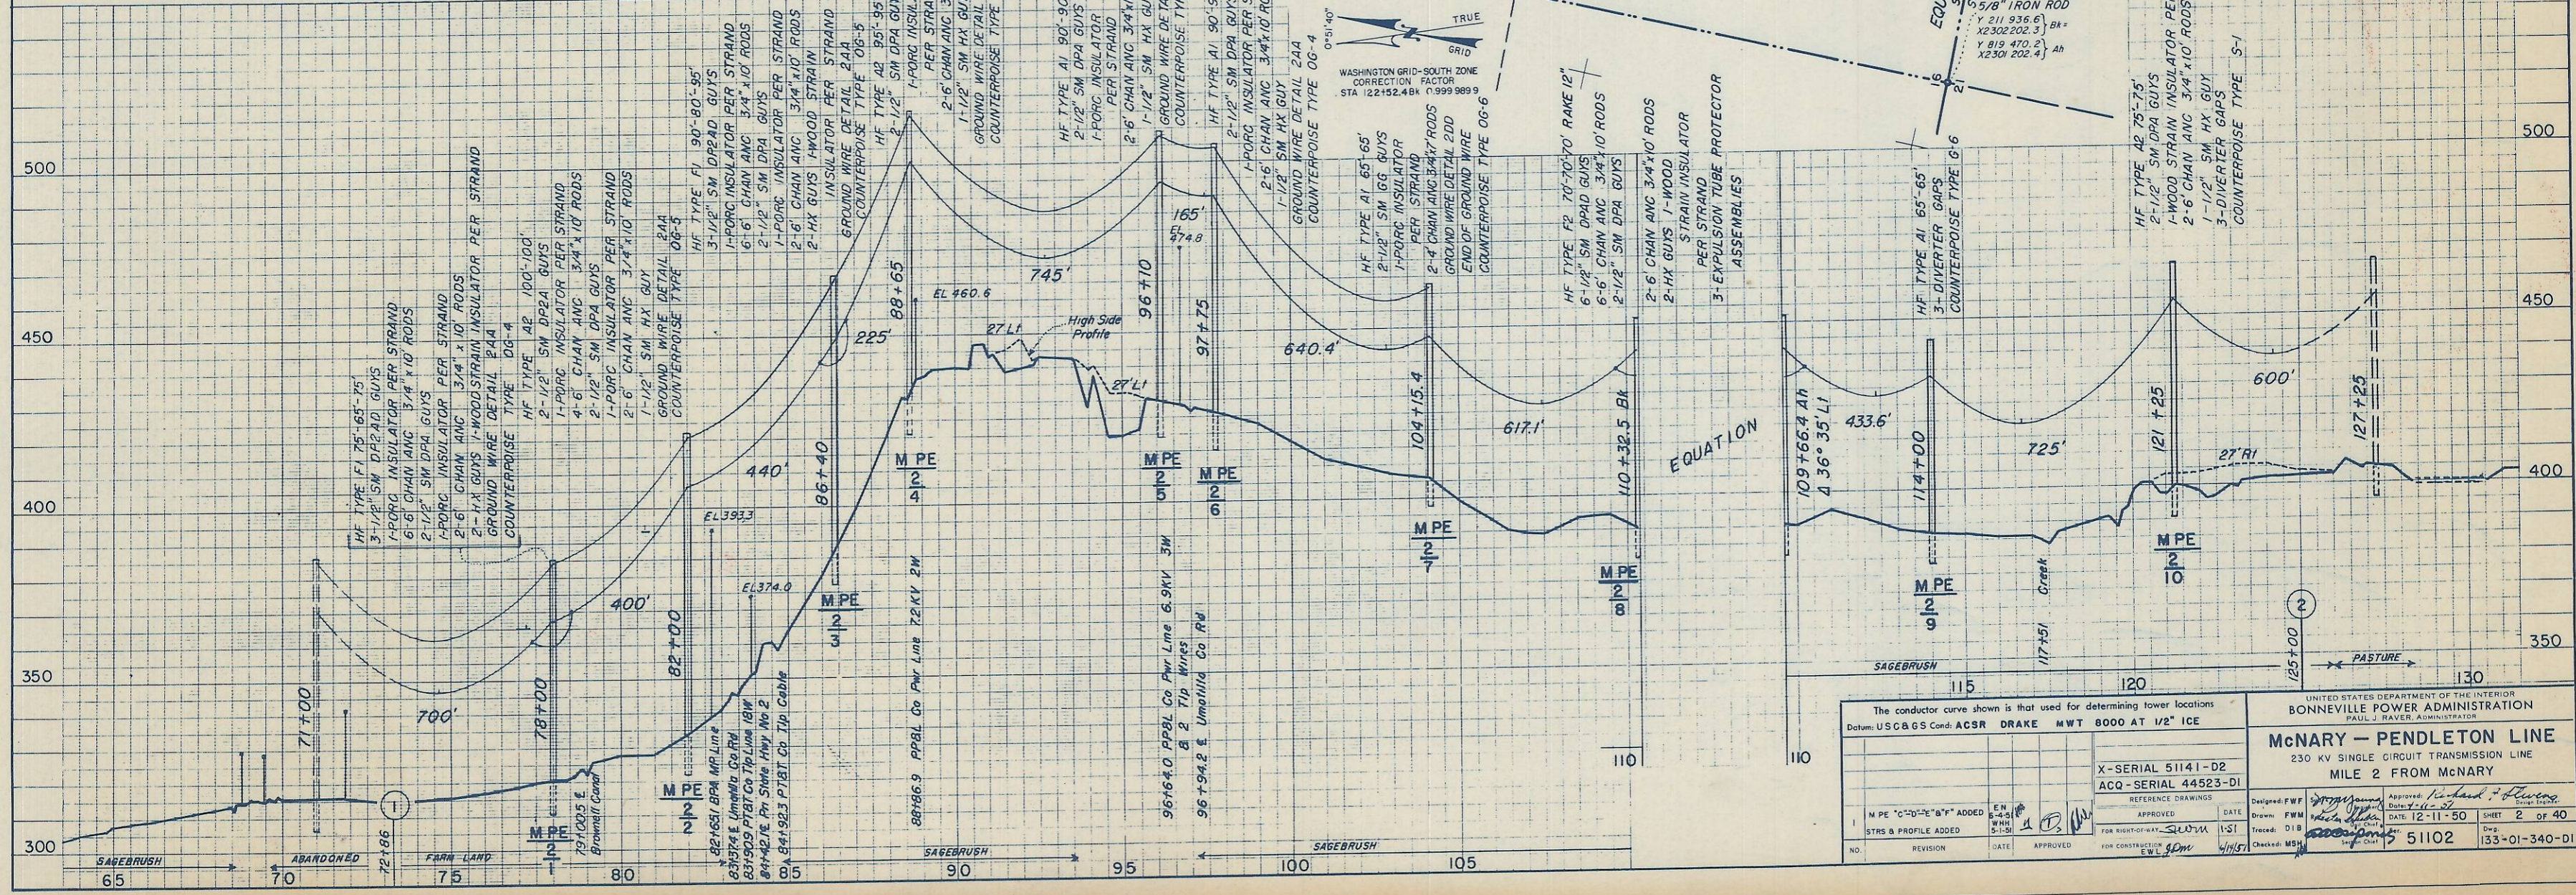
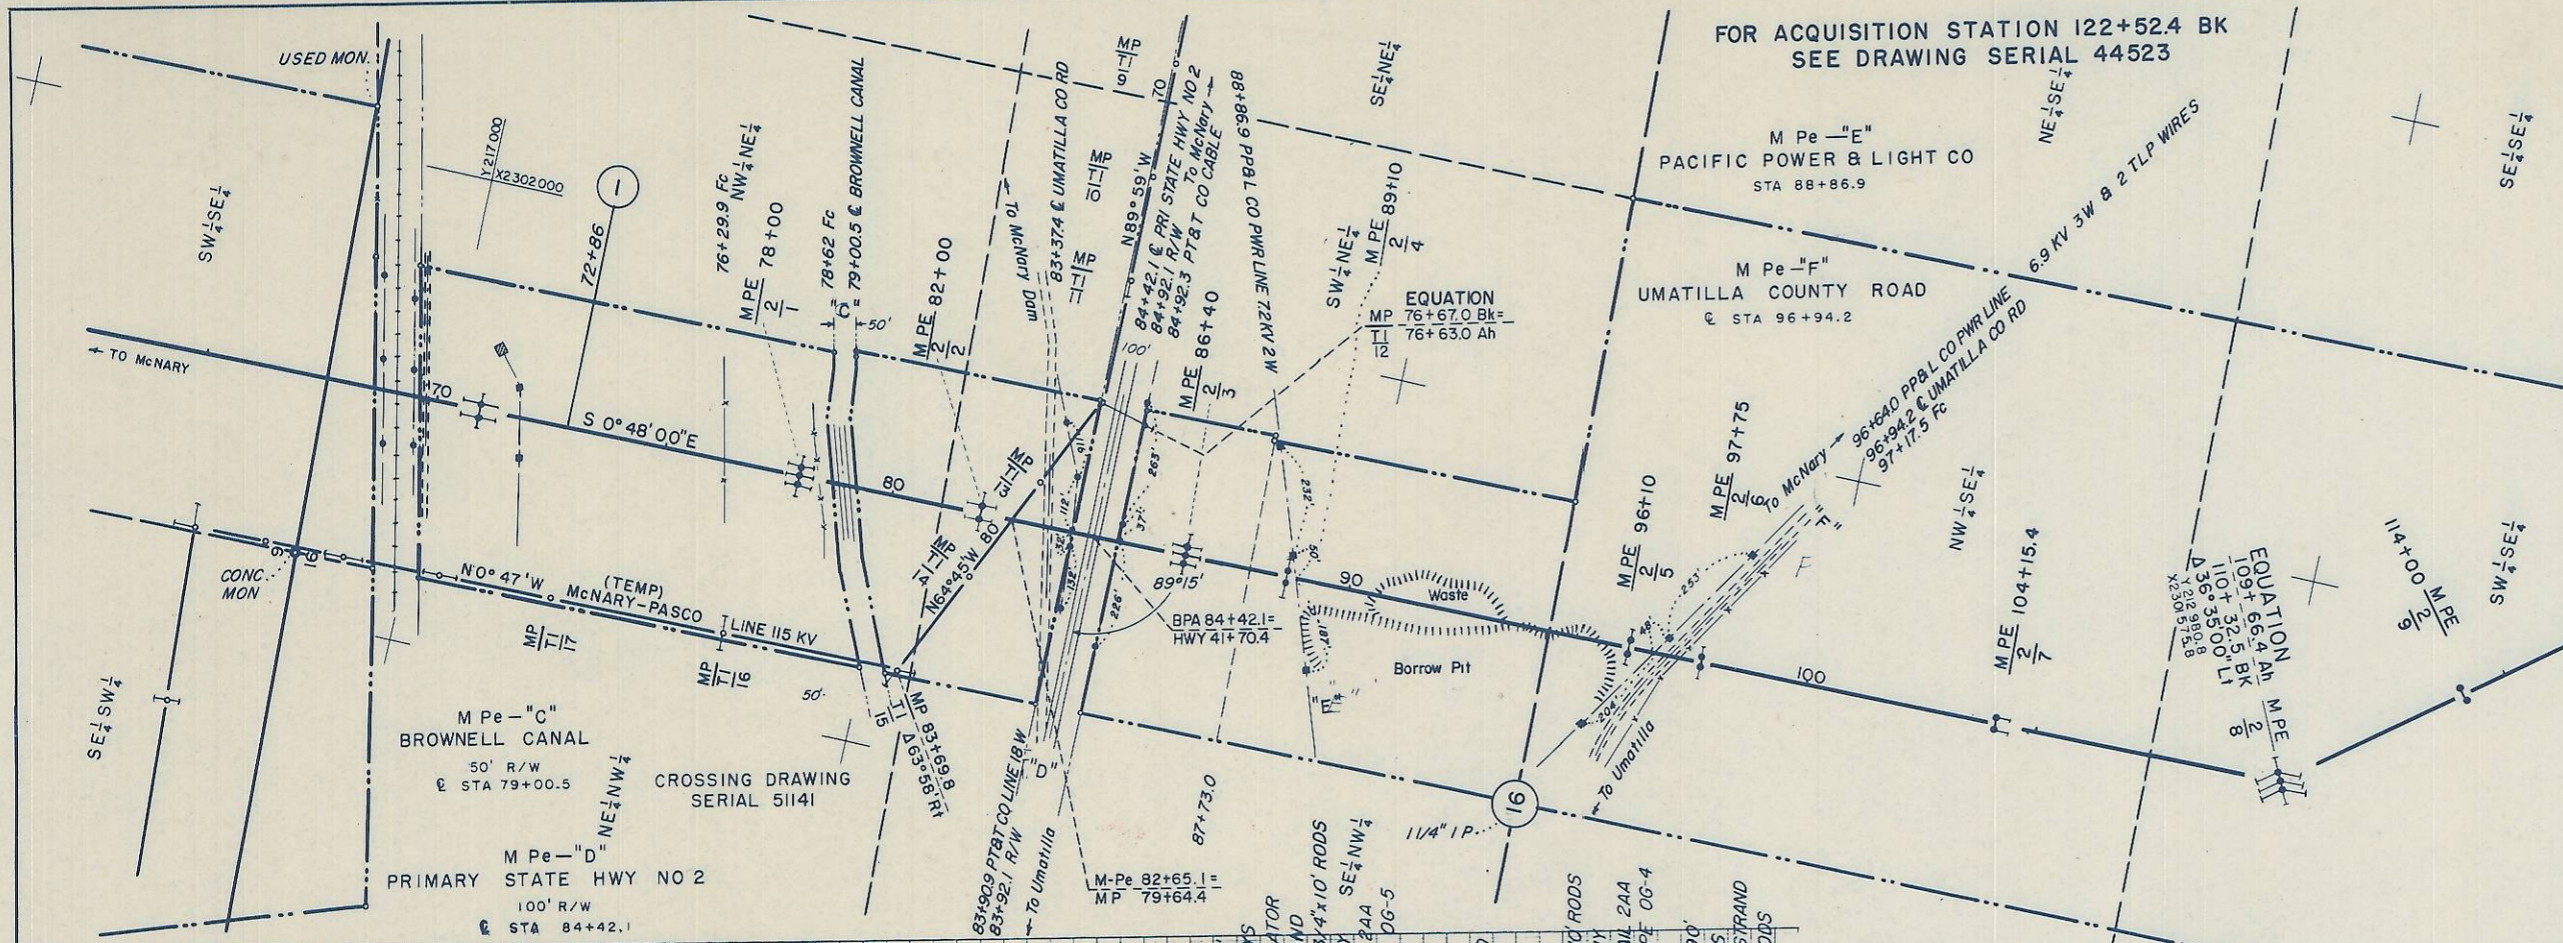


FOR ACQUISITION STATION 122+52.4 BK  
SEE DRAWING SERIAL 44523

M Pe-1  
JESSE GOFF  
N 1/2 NE 2 SEC 21  
R/W & LENGTH 167'8"  
9.6 ACRES  
STA 122+52.4 TO STA 139+30.0

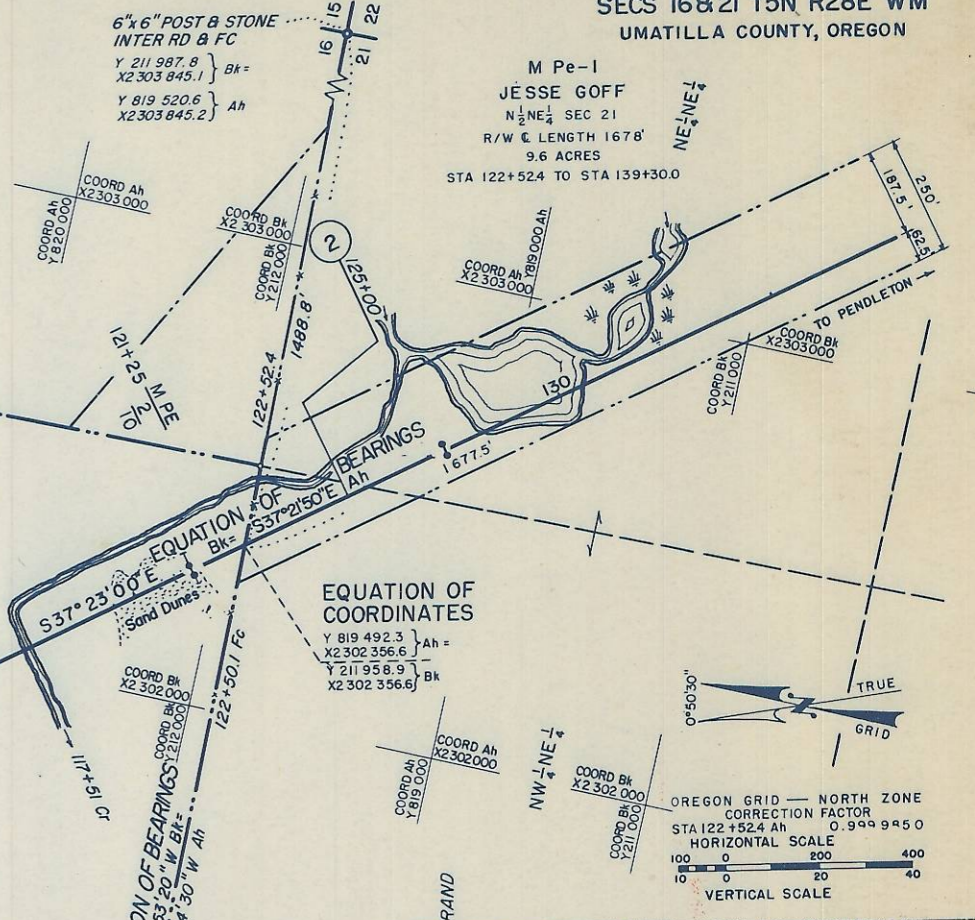

The conductor curve shown is that used for determining tower locations Datum: USCGS Coord: ACSR DRAKE MWT 8000 AT 1/2" ICE		UNITED STATES DEPARTMENT OF THE INTERIOR BONNEVILLE POWER ADMINISTRATION PAUL J. RAVER, ADMINISTRATOR	
X-SERIAL 51141-D2 ACQ-SERIAL 44523-D1		<b>McNARY - PENDLETON LINE</b> 230 KV SINGLE CIRCUIT TRANSMISSION LINE MILE 2 FROM McNARY	
DESIGNED: FWM	DATE: 12-11-50	SHEET: 2 OF 40	APPROVED: [Signature]
DRAWN: FWM	DATE: 12-11-50	CHECKED: DIB	DATE: 12-11-50
TRACED: DIB	DATE: 12-11-50	FOR CONSTRUCTION: EWL/gdm	DATE: 12-11-50
NO.	REVISION	DATE	APPROVED