


FOR PROFILE SEE DRWG SERIAL 51130A

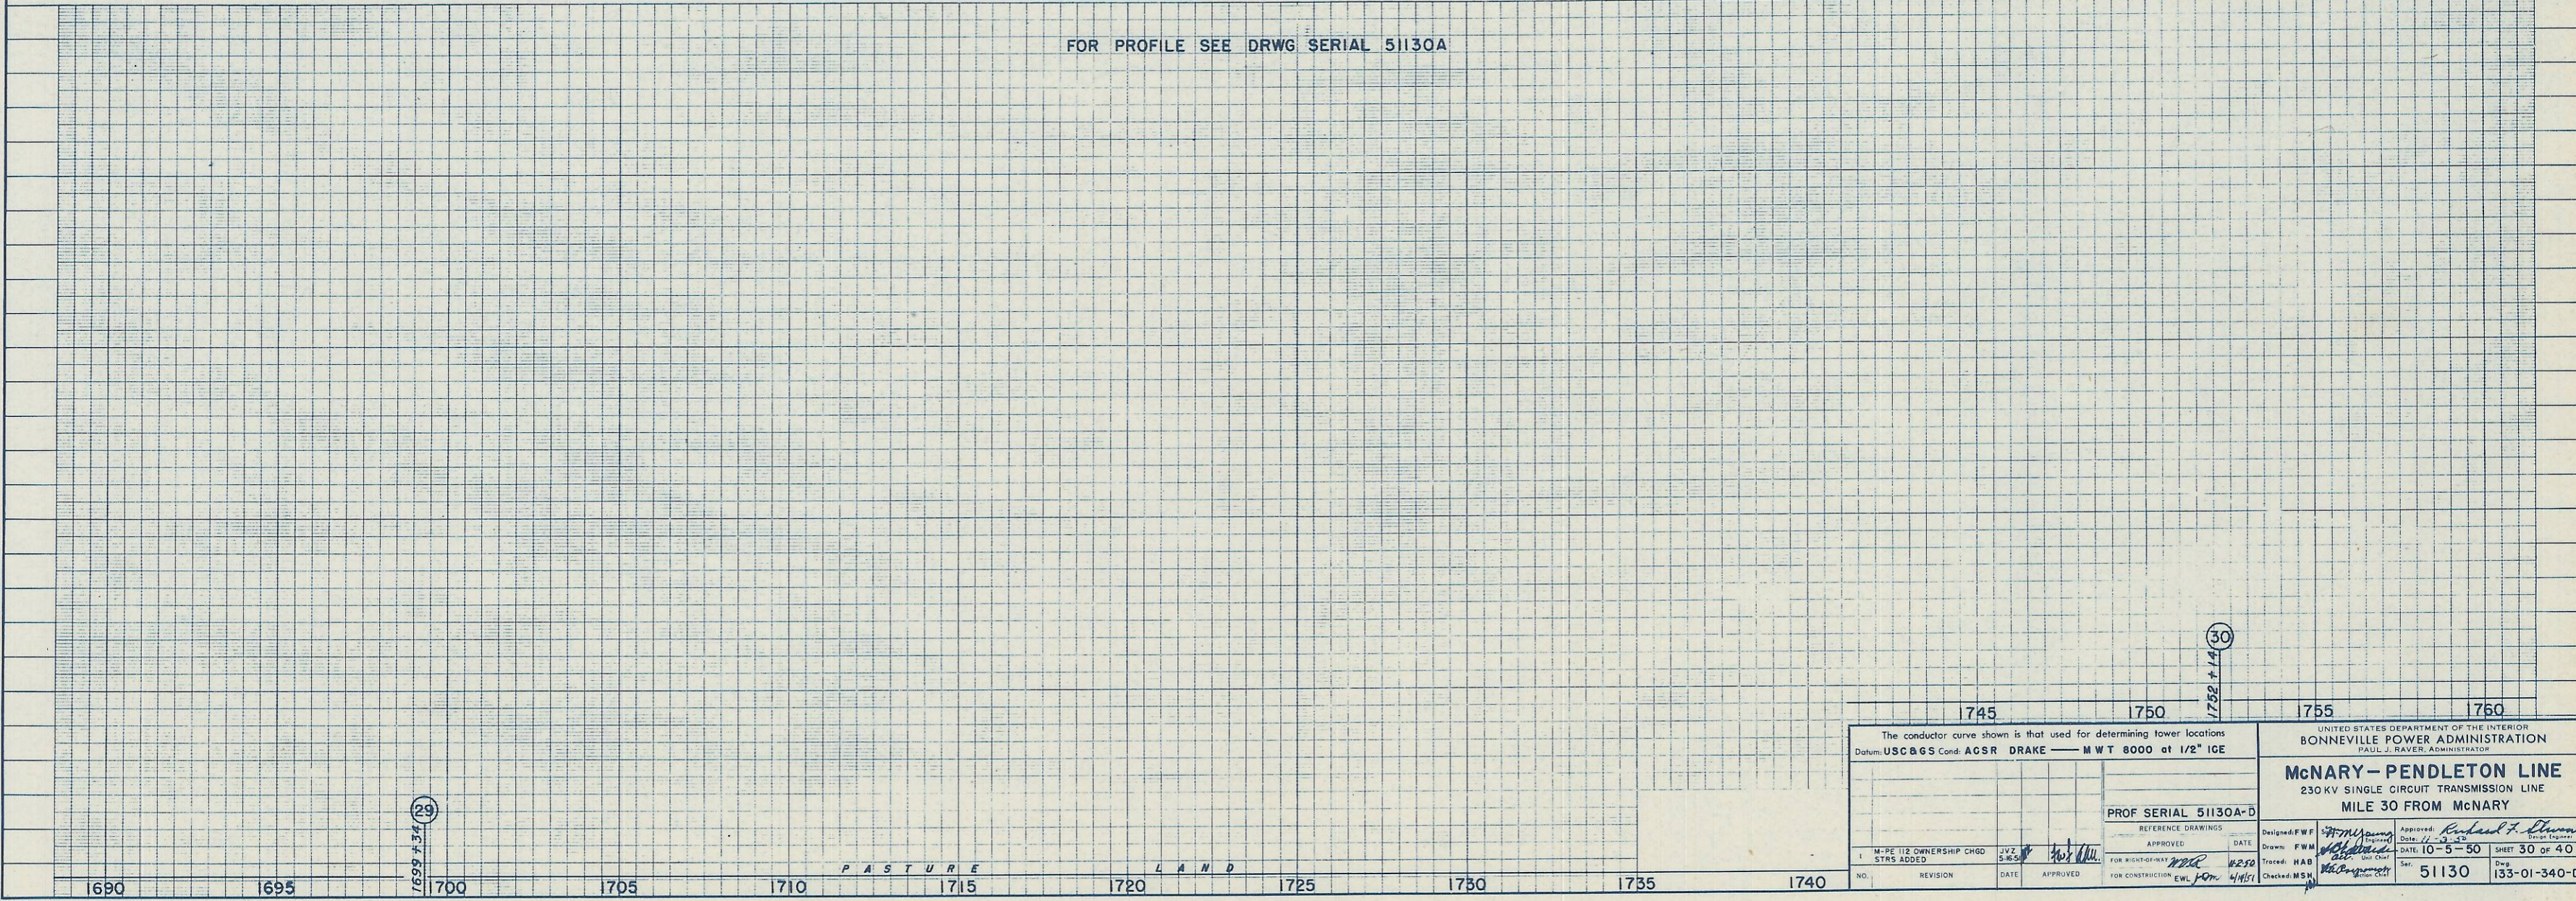

1745		1750		1755		1760	
The conductor curve shown is that used for determining tower locations Datum: USC & GS Cont. ACSR DRAKE — MWT 8000 at 1/2" ICE							
UNITED STATES DEPARTMENT OF THE INTERIOR BONNEVILLE POWER ADMINISTRATION PAUL J. BAVER, Administrator				McNARY - PENDLETON LINE 230 KV SINGLE CIRCUIT TRANSMISSION LINE MILE 30 FROM McNARY			
REFERENCE DRAWINGS APPROVED DATE DESIGNED DATE DRAWN DATE CHECKED DATE				DESIGNED DATE DRAWN DATE CHECKED DATE SHEET 30 OF 40			
NO. REVISION DATE APPROVED				NO. 51130 DATE 10-5-50 SHEET 30 OF 40			