



SECS 1, 12 & 7 T4N R28 & 29E WM
UMATILLA COUNTY, OREGON

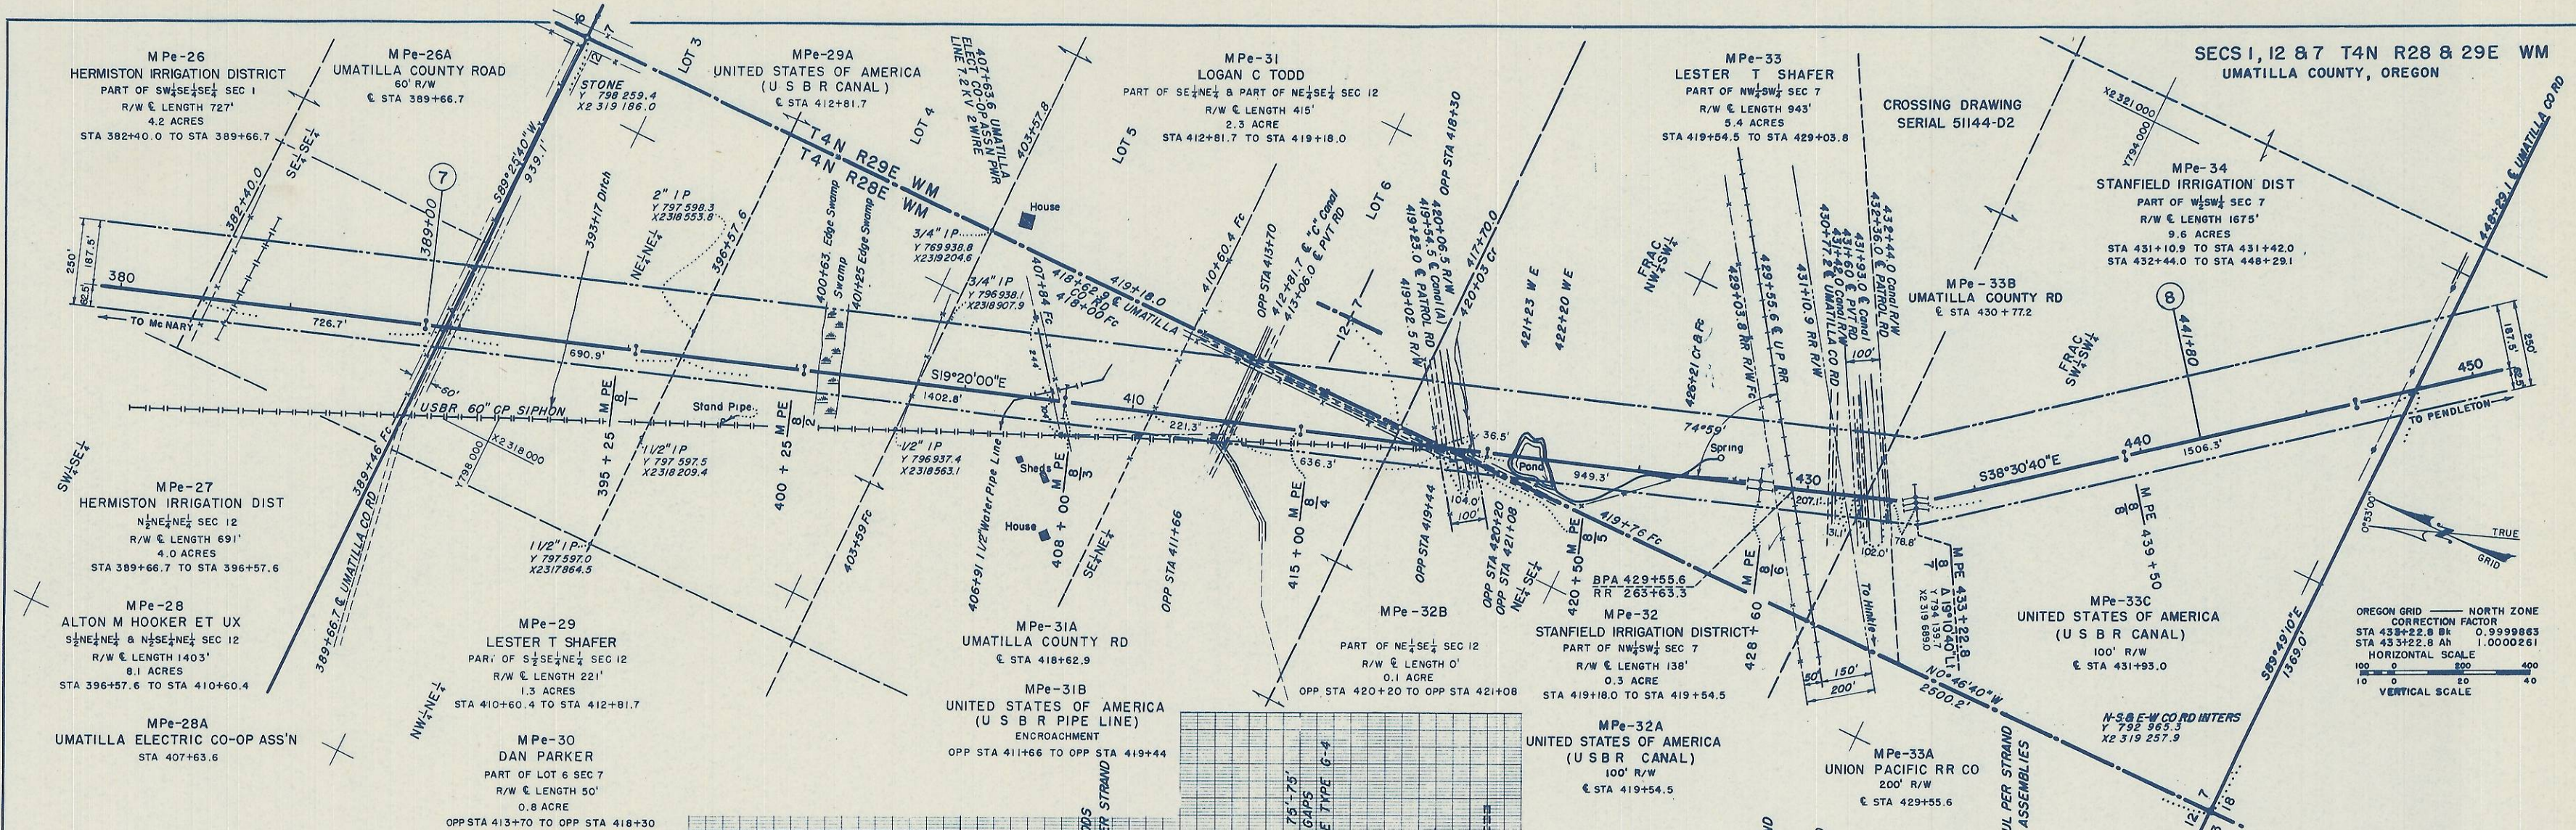

OREGON GRID — NORTH ZONE
CORRECTION FACTOR
STA 435+22.8 BK 0.9999863
STA 435+22.8 AH 1.0000261
HORIZONTAL SCALE
1" = 100'
VERTICAL SCALE
1" = 40'

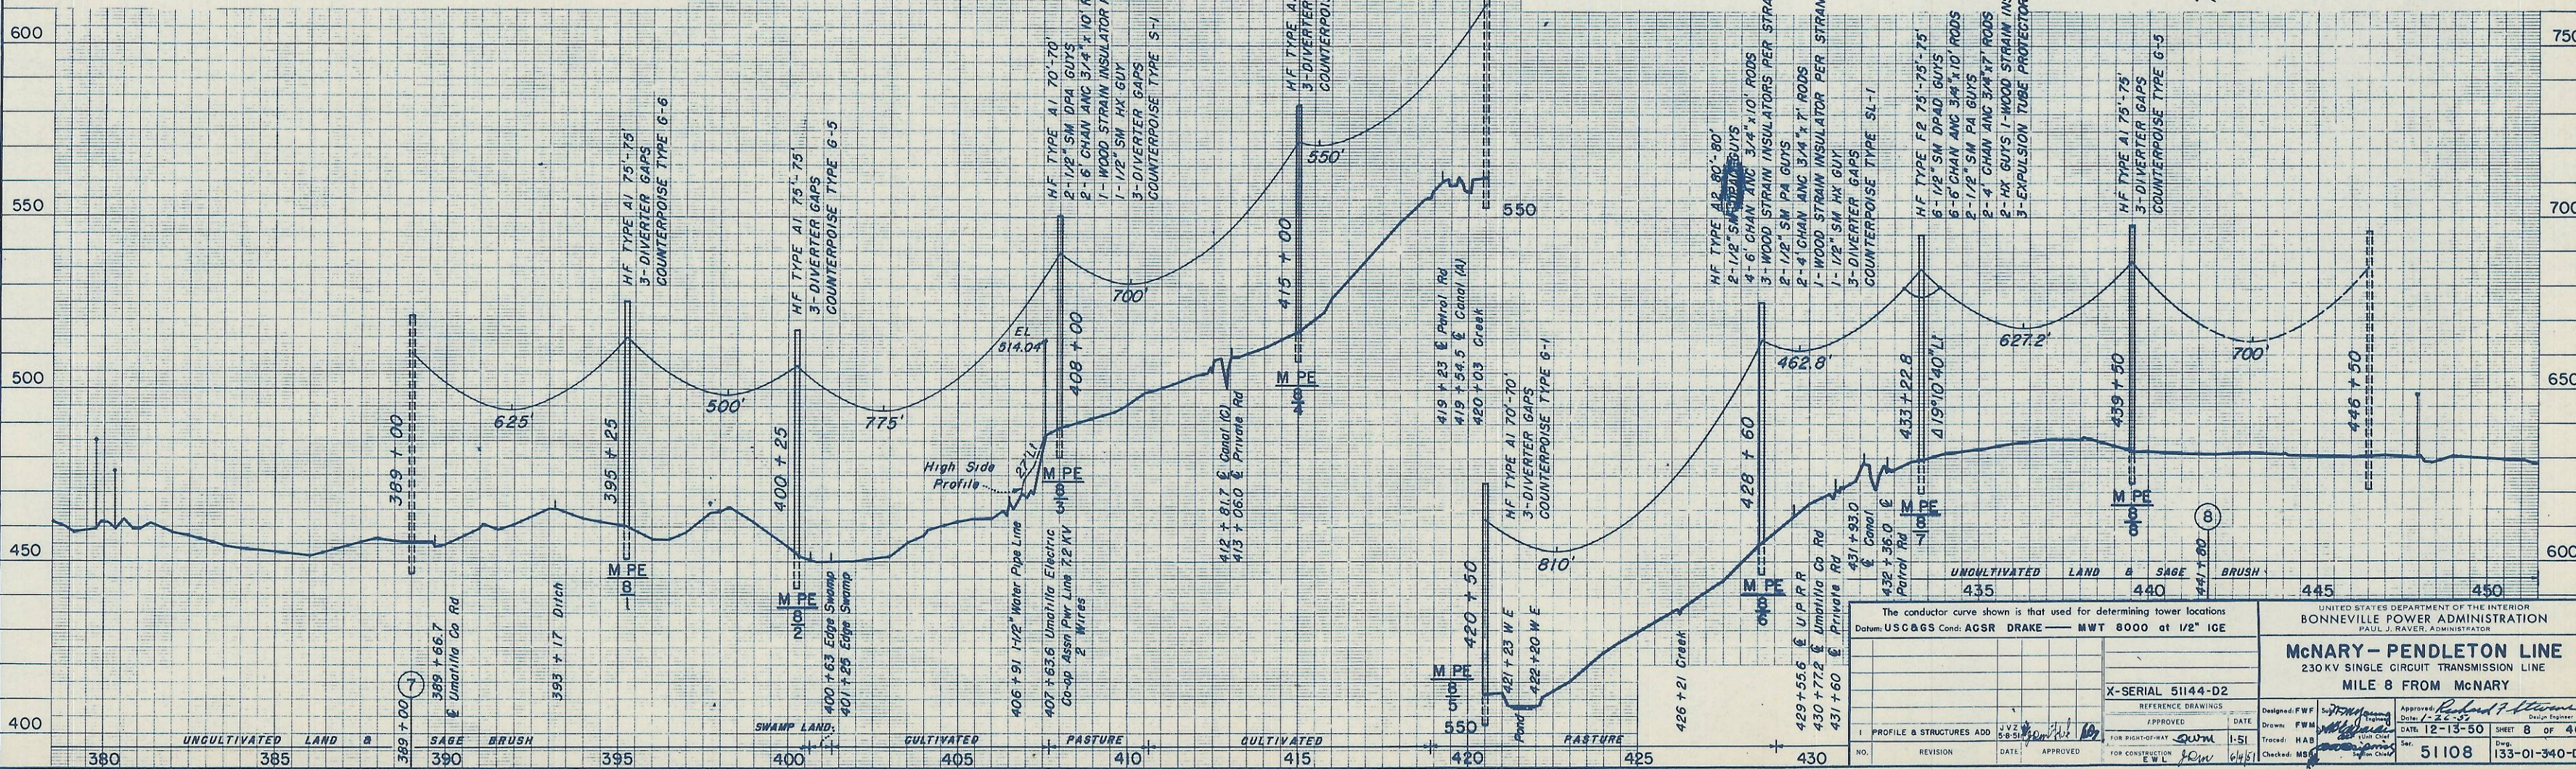

The conductor curve shown is that used for determining tower locations
Datum: USCGS Cond: AGRS DRAKE — MWT 8000 at 1/2" ICE

UNITED STATES DEPARTMENT OF THE INTERIOR
BONNEVILLE POWER ADMINISTRATION
PAUL J. RAVER, ADMINISTRATOR

McNARY - PENDLETON LINE
230KV SINGLE CIRCUIT TRANSMISSION LINE
MILE 8 FROM McNARY

X-SERIAL 51144-D2

DESIGNED: FWF
DRAWN: FWF
CHECKED: MBS
DATE: 12-13-50
SHEET 8 OF 40

APPROVED: [Signature]
DATE: 12-13-50
SHEET 8 OF 40

NO. 51108
DATE: 6/1/51
FOR CONSTRUCTION