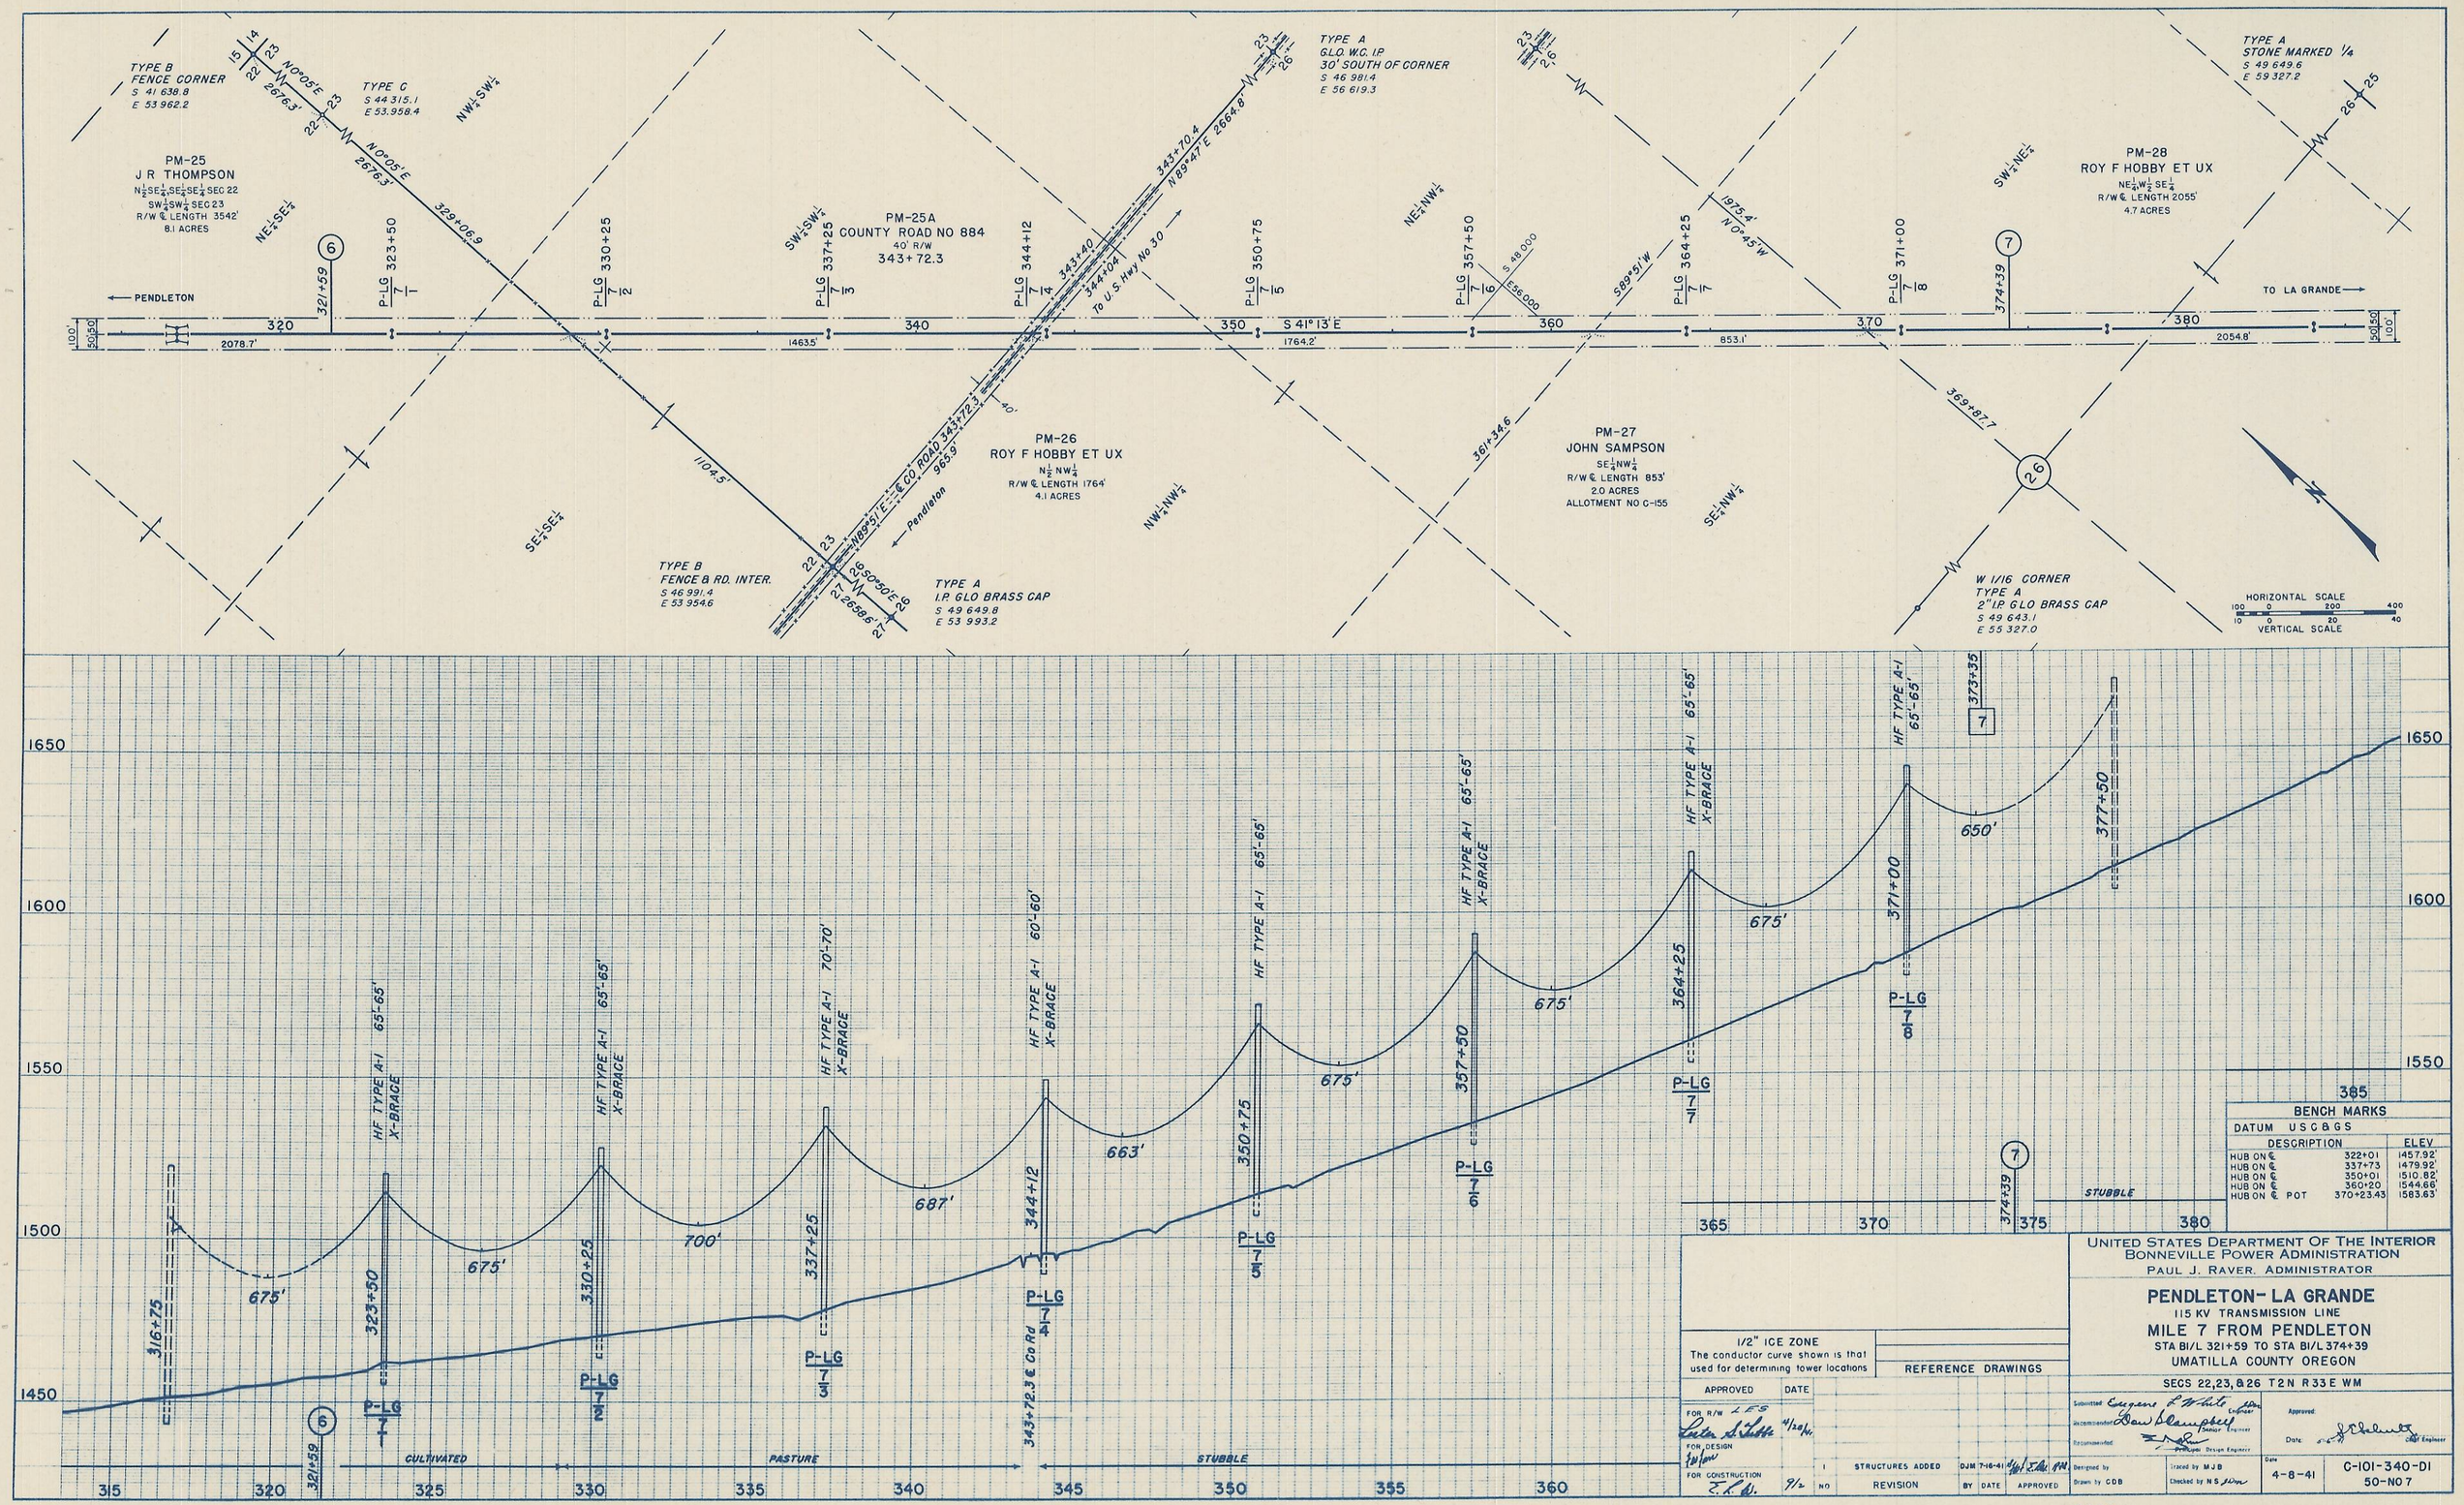

BENCH MARKS		
DATUM USC&GS		
DESCRIPTION		ELEV
HUB ON ℄	322+01	1457.92'
HUB ON ℄	337+73	1479.92'
HUB ON ℄	350+01	1510.82'
HUB ON ℄	360+20	1544.66'
HUB ON ℄ POT	370+23.43	1583.63'

1/2" ICE ZONE
The conductor curve shown is that used for determining tower locations

REFERENCE DRAWINGS

APPROVED	DATE
FOR R/W LES Lester S. Tubbs	4/20/41
FOR DESIGN	
FOR CONSTRUCTION E.L.W.	9/2

NO	REVISION	BY	DATE	APPROVED
1	STRUCTURES ADDED	DJM	7-16-41	

UNITED STATES DEPARTMENT OF THE INTERIOR
BONNEVILLE POWER ADMINISTRATION
PAUL J. RAVER, ADMINISTRATOR

PENDLETON- LA GRANDE

115 KV TRANSMISSION LINE

MILE 7 FROM PENDLETON

STA BI/L 321+59 TO STA BI/L 374+39
UMATILLA COUNTY OREGON

SECS 22,23,&26 T2N R33E WM

Submitted Eugene L White Engineer
Recommended Don Campbell Senior Engineer
Recommended Principal Design Engineer
Approved: Date: 5-6-41 Chief Engineer

Designed by
Drawn by CDB
Traced by MJB
Checked by NS

Date 4-8-41

C-101-340-D1
50-NO 7

13207